



HINDUSTAN DORR-OLIVER LIMITED

Ref. No. SN556/LSTK 6/FW-IOCL PDR/SKM300711
Date: 30th July '2011

To,
Gandhi & Associates
A1-436, GIDC
Vadodara-390010

Ref. No.: PO no-4530006632 Dated:-10.09.10
Subject : - Hydro test completion Certificate of FRP Tank (101-TK-009 A/B)

Dear Sir,


As per drawing two nos of Acid storage tanks (101-TK-009 A/B) have fabricated here successfully by your team. Hydro test of both tanks had been completed successfully on 26th July 2011. Acetone test & Barcol hardness test also done on 26th July 2011 in our presence.

This is for your record please.

Thanking you

Very Truly Yours,
For Hindustan Dorr Oliver Ltd.

K.K. Sutar
(K.K. Sutar)
Mech. Engineer

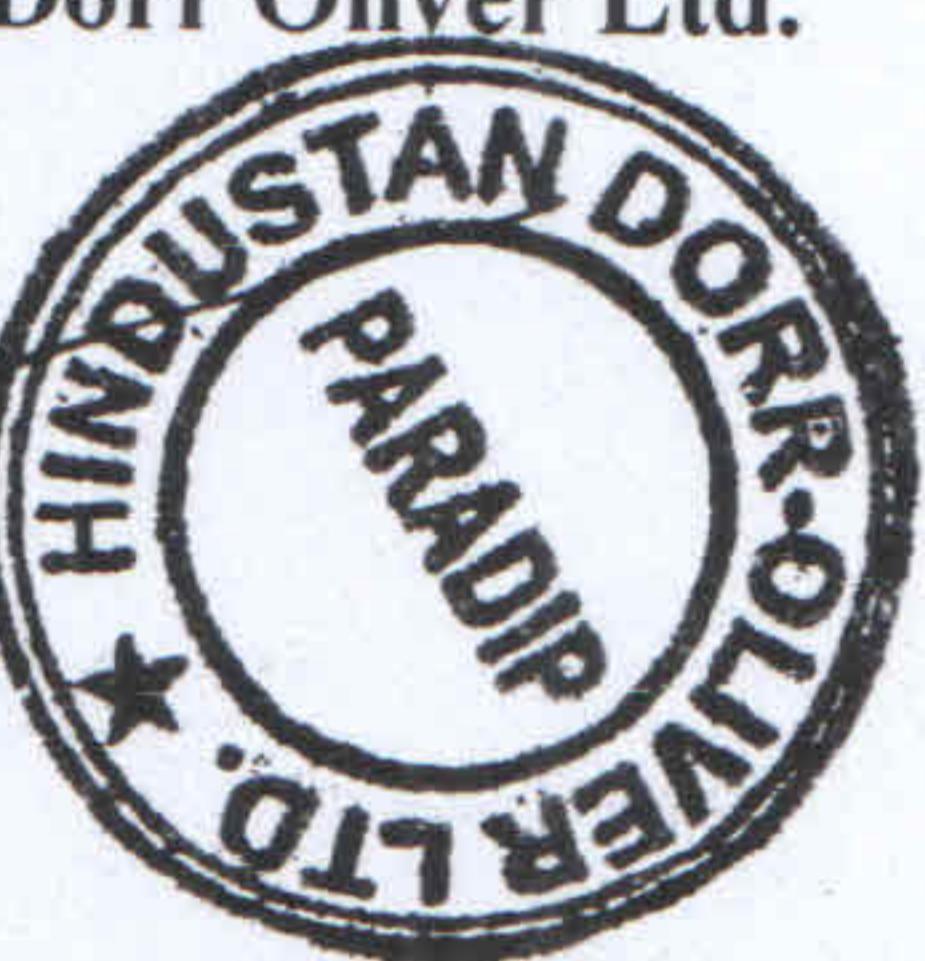

Received.

G. Patel.
30/07/11
GAURAV PATEL
for Gandhi & Associates